



BacNet Gateway on building subnet

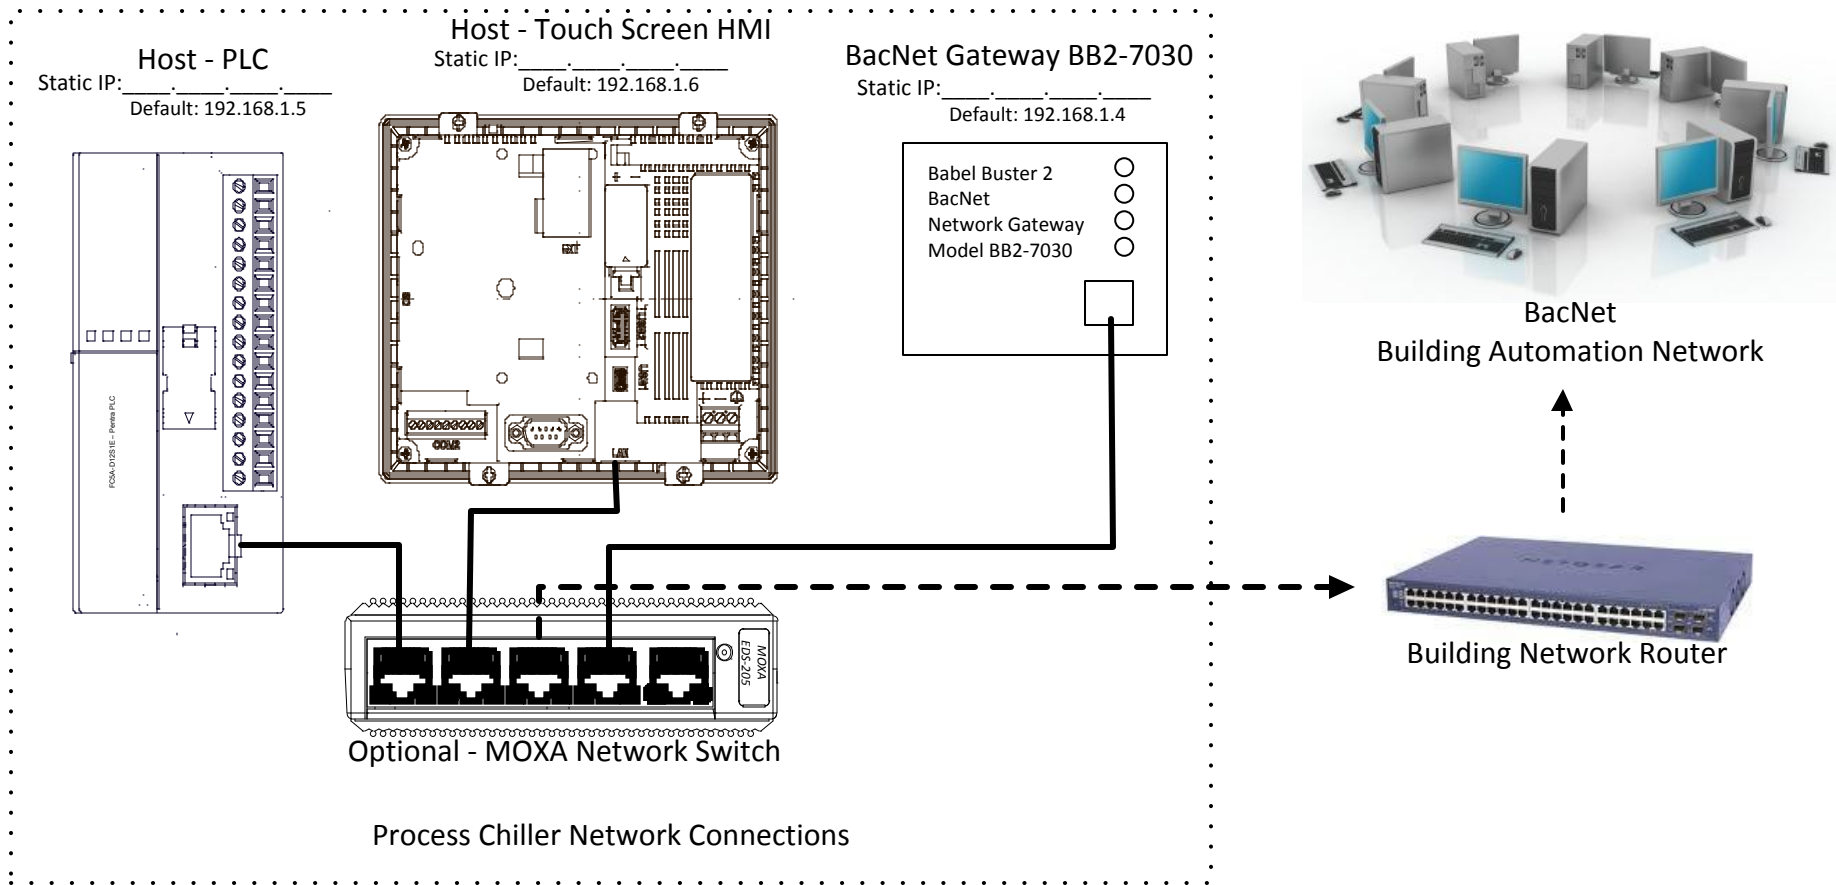

Comments: 1. Dashed network connection (Standard CAT 5/6 Ethernet cable) provided by others. 2. Once HMI, PLC and BacNet Gateway are properly configured, the HMI can be accessed from any work station on the designated network subnet using Firefox and Internet Explorer. The BacNet Gateway can be accessed from the buildings automation system using BacNet auto discovery. 3. IMPORTANT: In order to access this equipment on the buildings subnet, the HMI, PLC and BacNet Gateway must be programmed with static IP addresses provided by the buildings network administrator. 4. Once the building subnet static IP addresses are downloaded to the HMI and PLC devices (via the HMI's USB slot), the devices are classified as OEM and excluded from Legacy complimentary software update program.

	Networking design subject to change without notice			
	Copyright – 2014, Legacy Chiller Systems, Inc.			
Drawn by: Mking	SIZE NA	FSCM NO NA	DWG NO NA	REV 1
Rev date: 5-14-14	SCALE	NONE	SHEET	1 OF 1