



# Remote HMI Web server configuration using building subnet

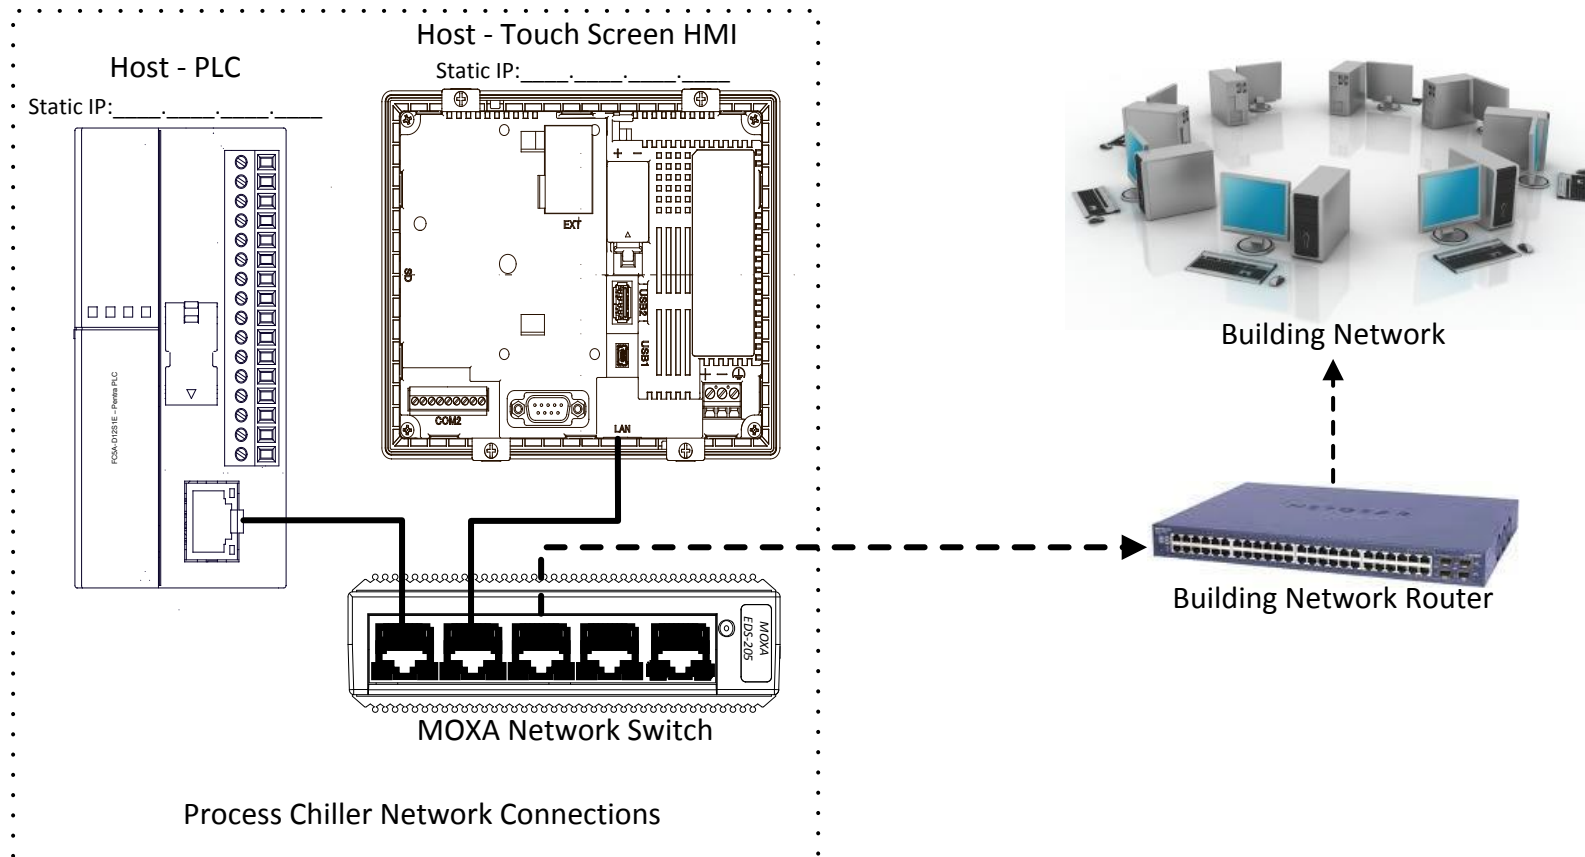

**Comments:** 1. Dashed network connection (Standard CAT 5/6 Ethernet cable) provided by others. 2. Once HMI and PLC are properly configured, the HMI can be accessed from any work station on the designated network subnet using Firefox and Internet Explorer. 3. IMPORTANT: In order to access the HMI on the buildings subnet, the HMI and PLC must be programmed (by Legacy Engineering) with static IP addresses provided by customer. 4. Once the building subnet static IP addresses are downloaded to the HMI and PLC devices (via the HMI's USB slot), the devices are classified as OEM and excluded from Legacy complimentary software update program.

	Networking design subject to change without notice			
	Copyright – 2013, Legacy Chiller Systems, Inc.			
Drawn by: Mking	SIZE NA	FSCM NO NA	DWG NO NA	REV 1
Rev date: 9-28-13	SCALE	NONE	SHEET	1 OF 1